


# **Total Coliform Rule – Sampling & Public Notice Flow Chart** Vermont Drinking Water and Groundwater Protection Division

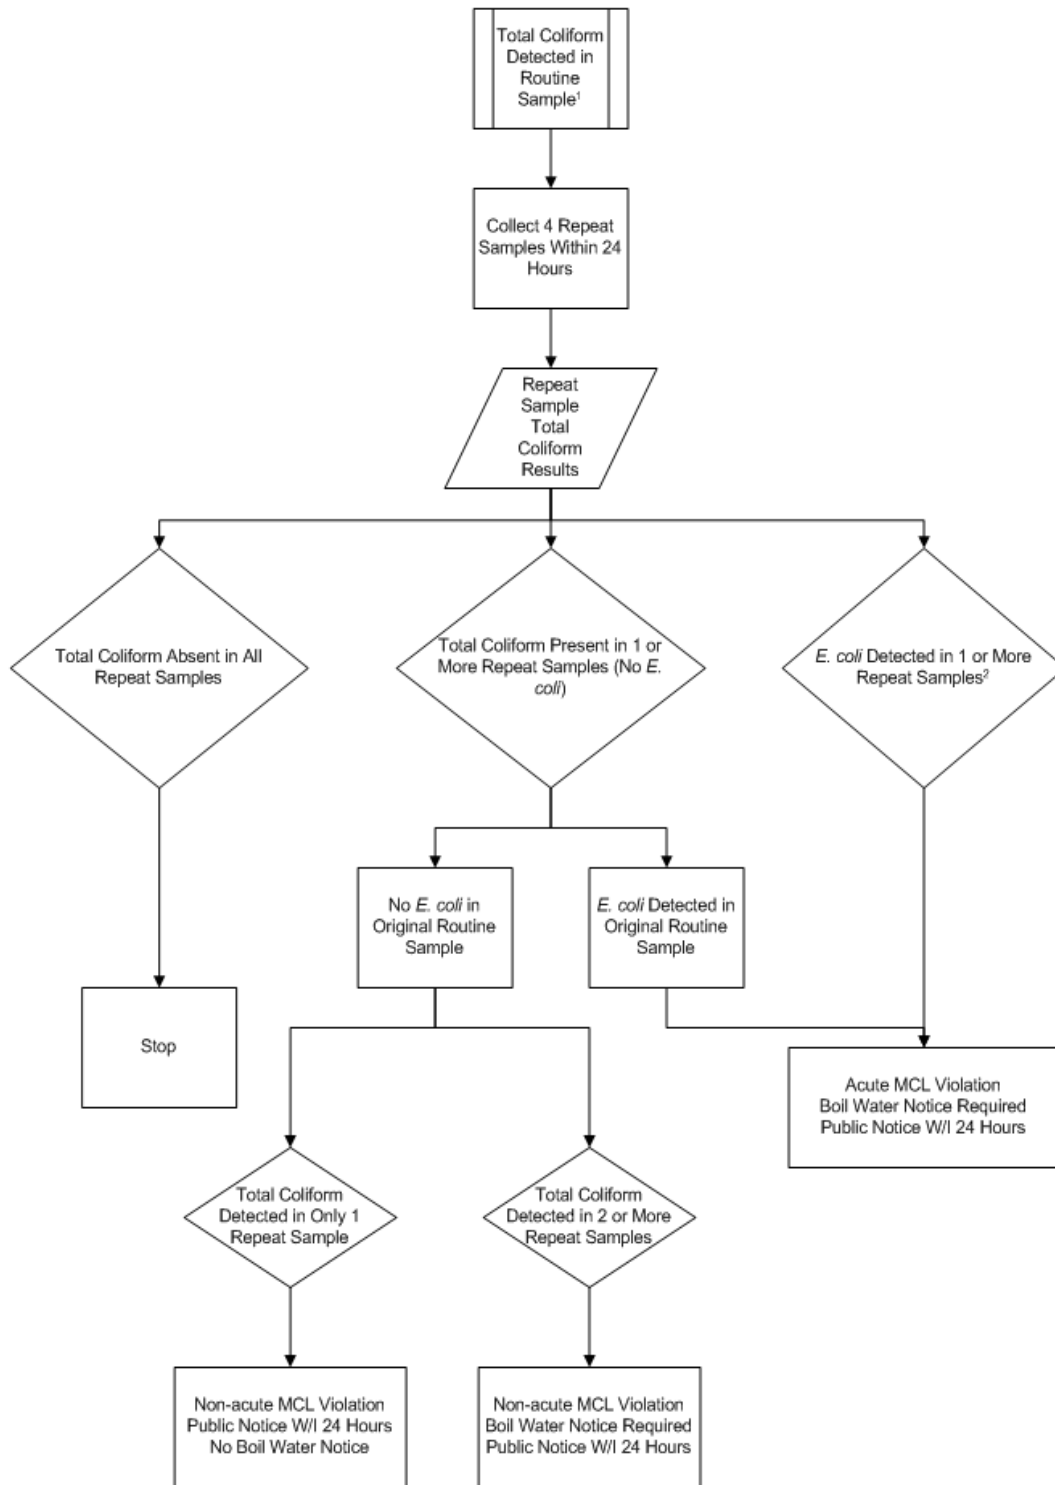

**Footnotes:**

1. The water system must collect 5 routine samples during the calendar month following the initial total coliform detection. These samples may be taken at any time during the month, but must be collected from locations in accordance with the bacteriological sampling plan.
2. The water system is required to contact WSD within 24 hours of being notified of total coliform or *E. coli* detects in any repeat sample.